NFPA72 CODE REQUIREMENTS FOR VISUAL INSPECTIONS

INSPECTION TESTING AND MAINTENANCE
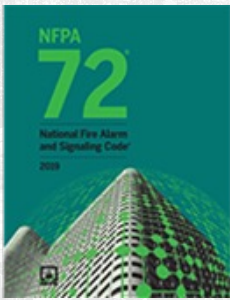

Semi Annually: Automatic Fire Alarm
NFPA 72 // ULC S536

- Control Unit Trouble Signals
- Emergency Voice Alarm Communications Equipment
- Remote Annunciators
- Batteries
  - Sealed Lead-Acid
- Initiating Devices
  - Air Sampling Smoke Detectors
  - Duct Smoke Detectors
  - Electromechanical Releasing Devices
  - Fire Extinguishing System(s) Switches
  - Suppression System(s) Switches
  - Fire Alarm Boxes (Pull Stations)
  - Heat Detectors
  - Smoke Detectors
  - Interface Equipment
  - Alarm Notification Appliances – Supervised
- Supervising Station Fire Alarm Systems –
- Transmitters DACT

Annually: Automatic Fire Alarm
NFPA 72 // ULC S536

Control Equipment:
- Fire Alarm Systems Unmonitored for Alarm, Supervisory, and Trouble Signals Fuses
- Interfaced Equipment
- Lamps and LEDS
- Primary (Main) Power Supply
- Radiant Energy Fire Detectors
- Supervisory Signal Devices
- Waterflow Devices

RAEL FIRE PROTECTION

Semi Annually: Automatic Fire Alarm
NFPA 72 // ULC S536

Control Equipment: Building Systems Connected to Supervising Station
- Functions, Fuses, Interface Equipment, Lamps &
- LEDs, Primary (main) Power Supply, Transponders
- Batteries: Fire Alarm Systems
- Control Unity Trouble Signs

Emergency Voice & Alarm Communication Equipment
- Remote Annunciators
- Initiating Devices
- Duct Smoke Detectors
- Electromechanical Releasing Devices
- Fire Extinguishing System(s) Switches
- Suppression System(s) Switches
- Fire Alarm Boxes (Pull Stations)
- Heat Detectors - Functional
- Fire, Gas & Other Detectors
- Interface Equipment
- Special Hazard Equipment

Annually: Automatic Fire Alarm
NFPA 72 // ULC S536

Alarm Notification Devices
- Audible Devices
- Audible Textual Notification Appliances
- Visible Devices

Supervising Station Fire Alarm System & Transmitters
- DACT
- DART
- Special Procedures